


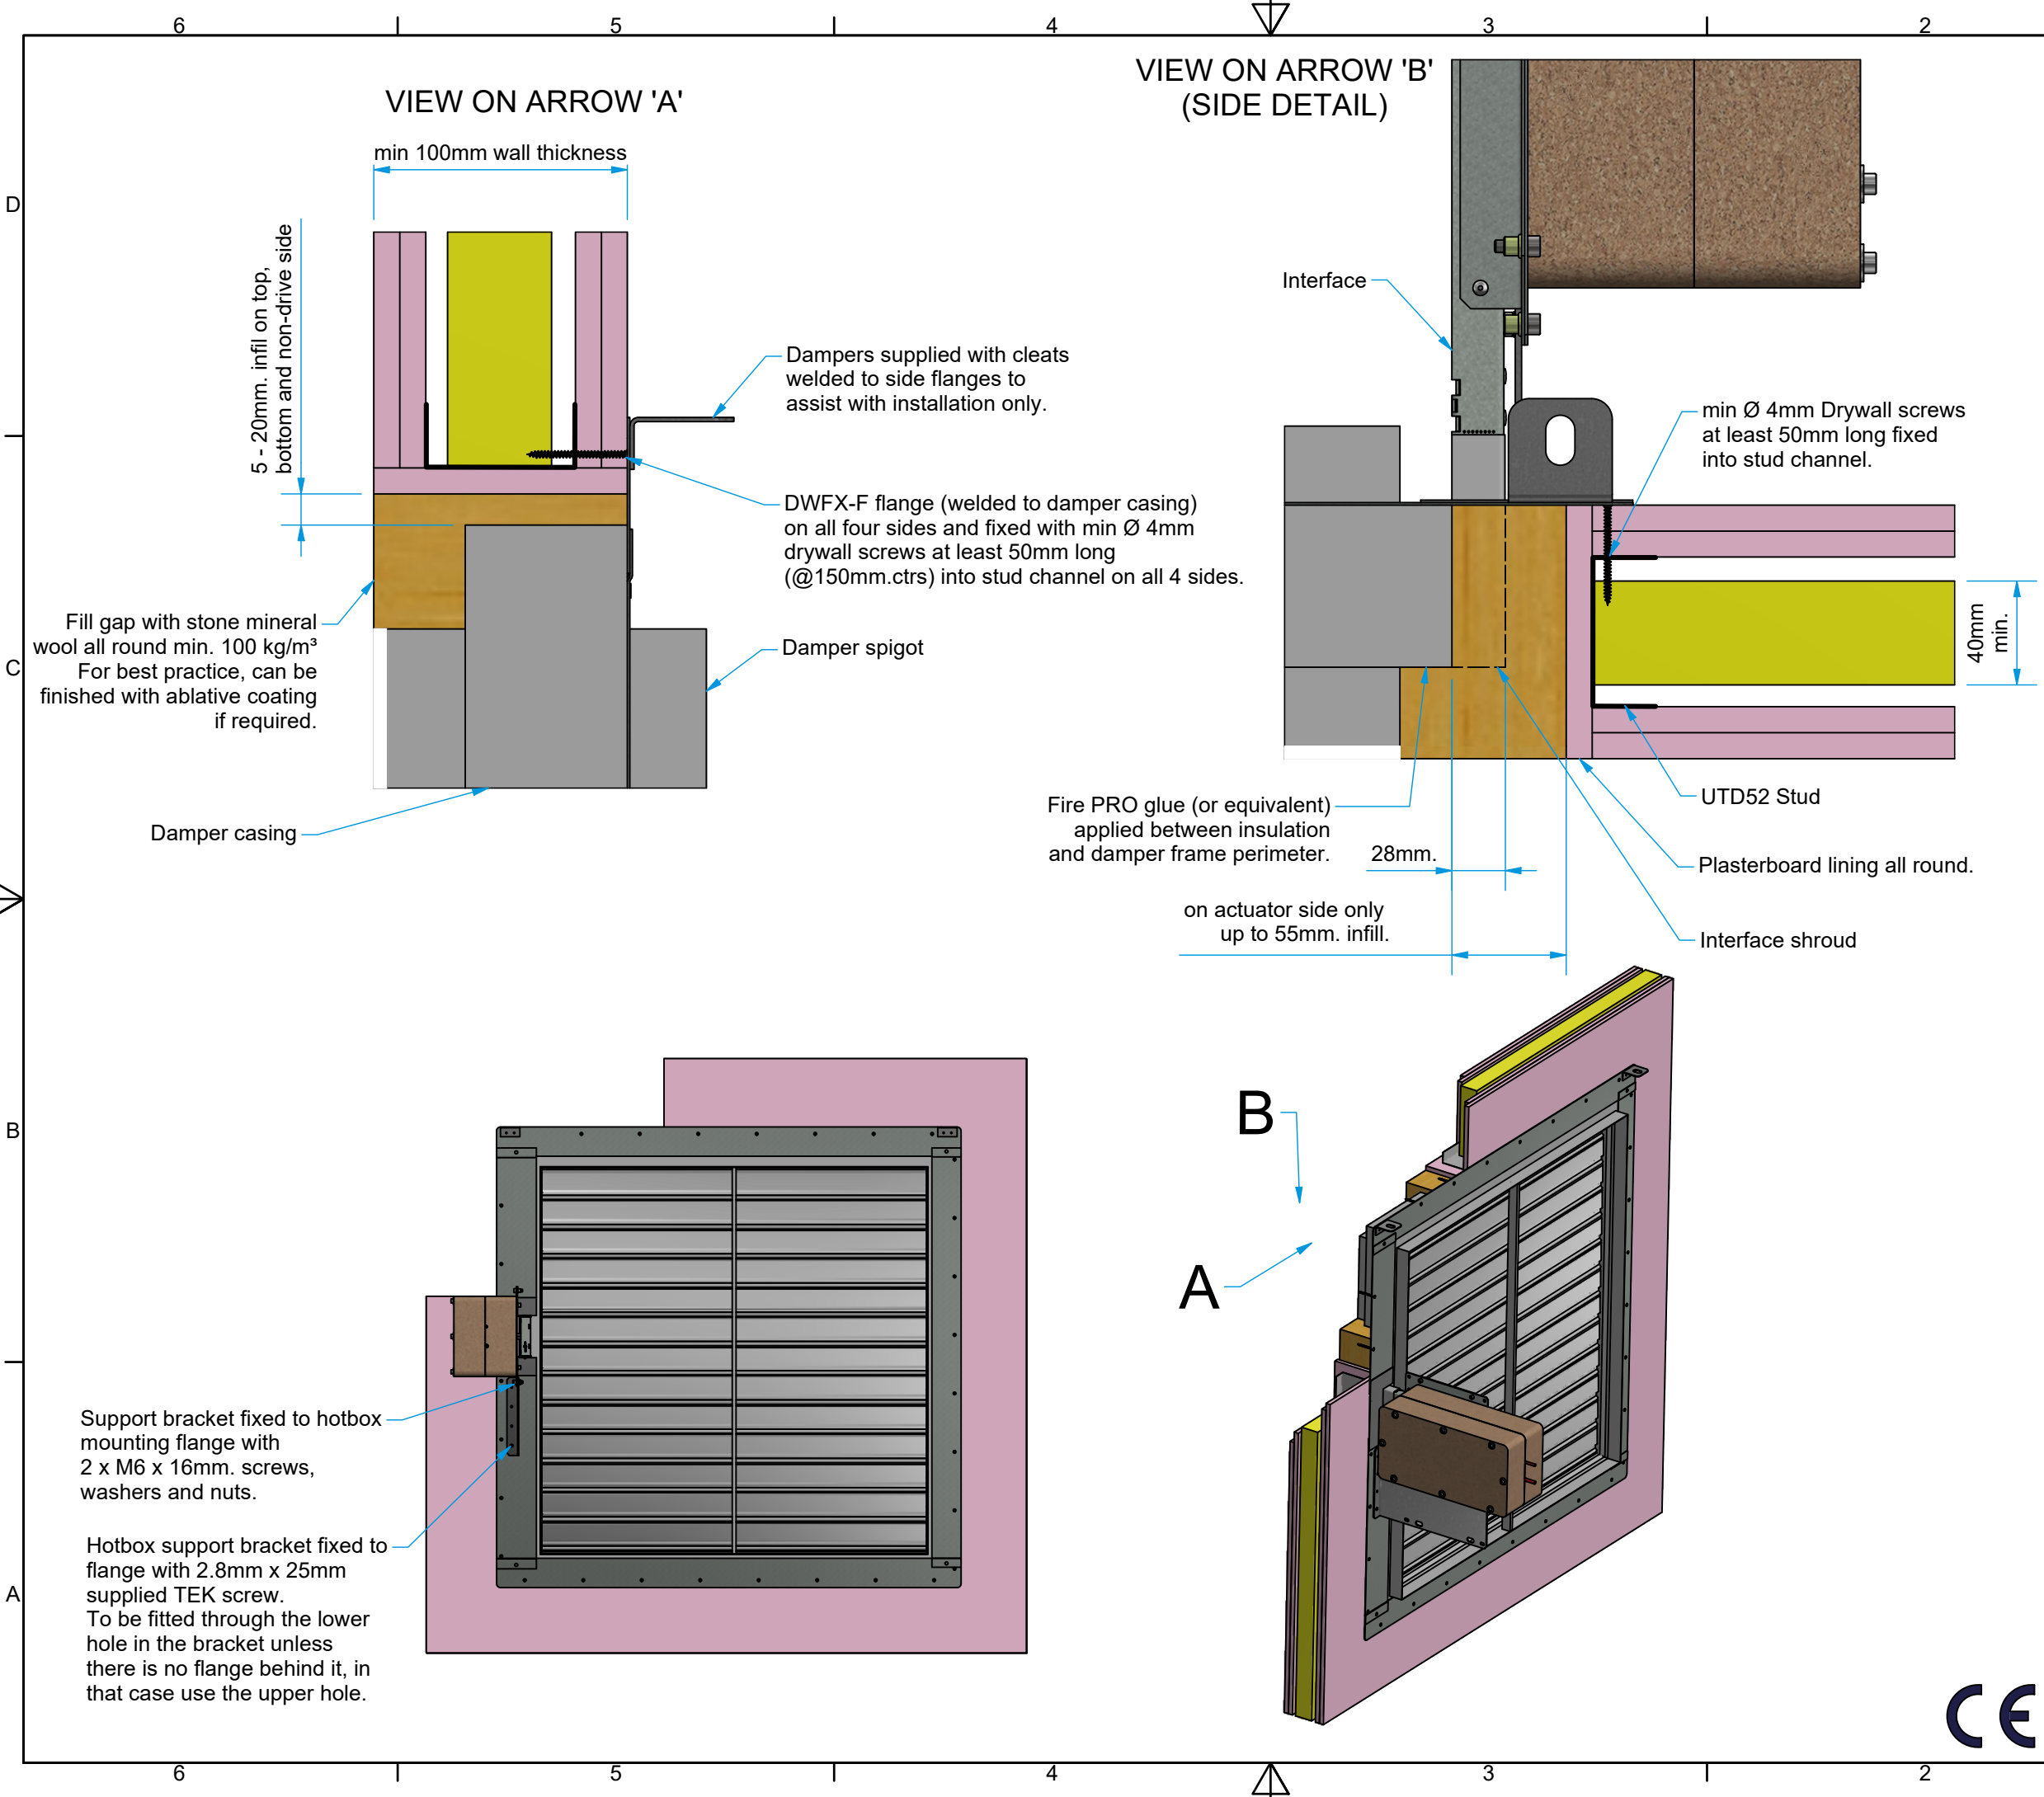

Installation Detail

If your proposed installation details differ from that shown here, please discuss this with the authority having jurisdiction, referencing this documentation.

Deviation from this drawing requires approval of the relevant authority.

Connecting ductwork omitted for clarity. Ductwork must be independently supported.

A minimum of 200mm between fire dampers installed in separate ducts and 75mm between fire damper and construction elements/edges needs to be observed unless otherwise specified in the drawing.



SCAN ME

Please refer to the DoP for latest classifications for CE/UKCA compliance and the Installation, Operation and Maintenance Guide

E	ECN2326	MJB	23-11-23
D	ECN2227	JPM	13/04/22
C	ECN1978	MJB	14-02-20
B	ECN1952	MJB	20-12-19
A	ECN 1945	MJB	14-08-19
Rev:	Comments:	By:	Date:

Drawn By: M. Bushell Date: 12/07/2019

Checked By: Date:

Approved By: Date:

Description:

VERTICAL APPLICATION
SMOKE COMMAND MCD
DAMPER DWFX-F IN
PLASTERBOARD WALL
Damper Size Range (mm)
200 x 200 to 1000 x 1000



Reference No: AAF12873	Sheet 1 of 1	Rev E
----------------------------------	------------------------	-----------------